

Report of the Tennessee Advisory Commission on Intergovernmental Relations

Fire Sprinkler Requirements for Places of Worship, Protecting People and Property

Contents

Fire Sprinkler Requirements for Places of Worship, Protecting People and Property..... 3

Risks Posed by Fires in Rural Places of Worship 4

 The Challenges of Fighting Rural Fires 5

 Risk of Collapse in Buildings with Large Auditoriums 7

 Difficulty of Safely Exiting Buildings that Accommodate Large Groups of People 7

Significance of Financial and Community Losses..... 8

Reducing Fire Losses in Rural Places of Worship 8

 Smoke Detectors and Remote Monitoring Systems..... 10

 Training and Full-Time Firefighters 10

 Access to Adequate Water Supplies 11

 Automatic Sprinkler Systems 12

Tennessee Requirements for Fire Sprinklers in Places of Worship 14

Proposed Legislation..... 15

 Exceptions for Places of Worship in Other States 16

References 19

Persons Interviewed 23

Persons Contacted 27

Appendix 31

Fire Sprinkler Requirements for Places of Worship, Protecting People and Property

From 2009 through 2013, there were 161 fires in places of worship in Tennessee. Those in places of worship without sprinklers that reported property losses caused an average of \$181,664 in damage per fire, nearly eight times the amount of damage caused in places of worship with sprinklers, \$23,657 per fire. No one died in any of these fires, but three firefighters were injured in places without sprinklers. Tennessee's experience demonstrates that sprinkler systems help suppress fires and reduce the risk of both injury and loss of life as well as the cost of property damage.

Like most states, Tennessee has required sprinkler systems in buildings with rooms designed to accommodate large groups of people, including places of worship, at least since the 1980s. Exiting these buildings safely in an emergency is difficult, especially during a fire. The panic that often ensues can further endanger the lives of the people in the structure as well as the firefighters called to the scene. The current building code requires places of worship to have sprinklers if the auditorium

1. exceeds 12,000 square feet,
2. has an occupant load of 300 or more, or
3. is located on a floor other than the level of the building exit.

Architects and engineers of places of assembly that accommodate 300 or more people, including places of worship, must submit plans that meet all building standards, including these sprinkler requirements, for approval by the state fire marshal's office before construction begins.

Automatic sprinkler systems are effective in 96% of fires when they are activated, and they are activated 91% of the time. When they are not activated, it's generally because someone shut the system off before or during the fire. National data show that sprinklers in places of worship contain a fire to its room of origin in 83% of all fires. Limiting a fire's spread is important for the safety of community members and firefighters. A National Institute of Occupational Safety and Health investigation of a 2004 fire that engulfed a church without sprinklers in Carthage, Tennessee, that resulted in one firefighter fatality and two firefighter injuries recommended installing sprinkler systems in places of worship.¹ The report noted that sprinklers reduce risks to community members and firefighters because they can contain fires until the fire department arrives.

In 2013, the Dyson Grove Baptist Church in Johnson County, Tennessee, moved into a new, larger building that the congregation had built on a rural site without access to a public water supply. The church was built without a sprinkler system, and the architect who designed it did not submit plans to the state fire marshal's office. A state electrical inspector, seeing that the

¹ Lutz 2006, 8.

plans were not approved, reported the violation to the state fire marshal's office, which required the church to submit plans. According to the state fire marshal's office, the church's sanctuary can accommodate 369 people, enough to require an automatic sprinkler system. The fire marshal's office is allowing the church to continue using the building while the architect and church members develop a plan to comply with the code, for example by reducing the size of the sanctuary or installing an automatic sprinkler system with a water tank and pump sufficient to support it as has been done in similar situations. Dyson Grove's architect has submitted new building plans with a sprinkler system supported by an underground water storage tank and a pump system. The fire marshal's office is reviewing these plans but has not yet approved them.

In the meantime, the Dyson Grove congregation, believing that their building should be exempt from the current sprinkler requirement, asked their legislators to change the law. In response to their request, a bill was introduced to exempt single-story places of worship located in unincorporated areas from state laws and regulations requiring places of assembly to have fire protection sprinkler systems as long as they

- have a capacity of no more than 400 persons;
- do not have a water supply located on the property;
- have a minimum of two exits, plus one additional exit for every 2,500 square feet or portion thereof over 4,500 square feet;
- have a fire alarm system;
- have fixed seating for at least 250 persons; and
- were built on or after July 1, 2012.

Only six states have exceptions such as these, and one of them—Florida—is considering eliminating theirs. Delaware and Massachusetts actually require sprinklers for smaller places of assembly than does Tennessee.

The House Local Government Subcommittee asked the Commission to study the proposed legislation, House Bill 1649 by Representative Timothy Hill (Senate Bill 1749 by Niceley; see appendix for a copy). Citing the threat that it posed to the health, safety, and welfare of the public, firefighters, and property, no engineers, architects, or fire officials interviewed by commission staff support the bill. For this reason and because reasonable means are available to support sprinkler systems where public water supplies cannot, the Commission does not recommend changing the state's building code to exempt places of worship in such areas from current fire safety requirements.

Risks Posed by Fires in Rural Places of Worship

Fires in rural places of worship are particularly dangerous for community members, firefighters, and property. Although from 2009 through 2013, there were no fire deaths or

injuries in rural places of worship in Tennessee, a 2011 University of Tennessee study found that people living in rural areas are at the highest overall risk for fire death in the state.² Nationwide, rural communities have a fire death rate that is twice that of non-rural communities.³ Fires in rural areas often cause more damage to property. The US Fire Administration reports that rural residential fires are almost twice as likely to spread throughout an entire structure as those in non-rural areas.⁴ From 2009 through 2013 in Tennessee, the average property value loss per fire in places of worship without sprinklers that reported damages was 36% in unincorporated areas compared with only 22% in incorporated areas.⁵ Fires in places of worship can also be emotionally burdensome because of the importance of these structures to the community, especially in small rural communities where they may be the only gathering place.

Three major factors contribute to the increased risk that fires in rural places of worship pose to the health, safety, and welfare of people and property:

1. Fighting rural fires is challenging.
2. Places of worship, like all structures with large auditoriums, are prone to collapse in fires.
3. Safely exiting places of worship during a fire is difficult.

These factors can be mitigated by installing smoke detectors, staffing fire departments with more full-time firefighters, improving access to water supplies, and installing automatic sprinkler systems. Some but not all of these options are available to rural churches such as the recently constructed Dyson Grove Baptist Church in Johnson County, which is seeking relief from current state building code requirements.

The Challenges of Fighting Rural Fires

Longer response times and limited access to water make fighting fires in rural places of worship more difficult. A recent example of the problems fire departments face in these cases occurred on January 24, 2014, when a fire destroyed the Lifespring Church outside the municipality of Greencastle, Indiana. The church was located almost five miles away and more than four miles from the nearest fire department. Over 100 firefighters—a mix of volunteers and professionals—responded to the fire, but their efforts were hindered by the distances they had to travel and their limited access to water. Because the church was in an area without fire

² Folz et al. 2011, 15.

³ Gamache et al. 2007, 7.

⁴ Gamache et al. 2007, 26.

⁵ Based on data received in an email from Peyton Bullen, Program and Policy Director, Tennessee Department of Commerce and Insurance, May 27, 2014. Property loss is calculated using the number of total fires with reported losses—7 of 12 fires with sprinklers and 71 of 94 without sprinklers had reported values. The data does not distinguish between fires with zero property damage and fires in which the person reporting it chose not to enter a value for property loss or total value of property in the national fire database.

hydrants and did not have water stored on site, the firefighters had to shuttle tanker trucks back and forth between the church and the towns of Greencastle and Bainbridge, 5 and 6 miles away by road. No one was hurt in the incident, but little was left of the building other than its exterior walls.⁶

The longer distances that firefighters must travel to reach rural fires and the difficulty of mobilizing volunteer firefighters increase the response times of even the best-trained, best-equipped departments. In Tennessee from 2009 through 2013, the average response time for church fires in municipalities was a little more than four minutes, while the average response time outside municipalities was nine and a half minutes.⁷ Fire stations tend to be farther apart in rural areas than in non-rural areas and are responsible for larger geographic areas. Some firefighters responding to the Lifespring Church fire came from more than thirty miles away.

Furthermore, many rural and unincorporated areas are served by majority volunteer fire departments. In Tennessee, 81% of fire departments, 575 of 709, are defined as volunteer forces.⁸ These firefighters, who are becoming more difficult to recruit and retain,⁹ often must travel from their homes or places of work to a fire station before responding to an incident.¹⁰ The longer time that it takes firefighters to arrive on scene in rural areas allows fires to grow larger, making them more difficult and more dangerous to extinguish.

Limited access to on-site water also increases the challenges for firefighters in rural areas and greatly increases the risks to property and people. In areas without fire hydrants, all water used to fight a fire must either be found in close proximity to the blaze or be transported to the site. Local streams, ponds, and wells often cannot provide sufficient water to fight a fire and can be difficult to access.¹¹ Without a sufficient water source on site, the fire department must transport all of the water needed to extinguish a fire in tanker trucks, which may not be able to carry enough water.

A 2011 church fire in a rural area outside of Muncie, Indiana, illustrates these problems well. A firefighter died when the roof of the building's sanctuary collapsed, trapping him inside. Several other firefighters were injured as they navigated pews and jumped through windows to escape the smoke-filled sanctuary. Investigative reports attributed the fire's deadliness to a number of factors. By the time firefighters arrived, the fire had engulfed the church's attic and begun to undermine the roof's lightweight wooden truss construction. Furthermore, firefighters had to rely solely on water from tanker trucks to fight the blaze because the church

⁶ Associated Press 2014 and WLKY 2014.

⁷ Based on data received in an email from Peyton Bullen, Program and Policy Director, Tennessee Department of Commerce and Insurance, May 27, 2014.

⁸ Data received in an email from Dennis Mulder, TFIRS Coordinator, Tennessee Department of Commerce and Insurance, August 19, 2014.

⁹ Lauer 2004, 39.

¹⁰ Bialik 2012.

¹¹ Cote 2003, section 10, page 33.

was located in a rural area without fire hydrants and did not have an automatic sprinkler system.¹²

Even under the best of conditions—even in incorporated areas with professional fire departments and sufficient fire hydrants—fighting fires is difficult. A 2013 fire that ignited after Sunday services at St. Mary Coptic Orthodox Church across the road from the Nashville International Airport destroyed the church sanctuary even though a fire hydrant was on-site and more than 75 professional firefighters responded with 35 fire engines, ladder trucks, and other support vehicles and worked for hours to extinguish the fire. Although a few people were inside the building when the fire started and the roof collapsed before the fire was extinguished, no one was hurt.¹³

Risk of Collapse in Buildings with Large Auditoriums

Roofs constructed with trusses spanning large spaces without additional support are prone to collapse in a fire. A truss's triangular shape provides structural rigidity under normal conditions but can deteriorate quickly and without warning in a fire, allowing the roof to collapse. Trusses can be particularly dangerous because the failure of even one can undermine the whole system and, when hidden from view in attics, can allow fires to grow unnoticed.¹⁴ Even so, because they are relatively inexpensive, they are often used in buildings with cathedral ceilings to span long distances and create unobstructed open spaces. The Dyson Grove Baptist Church is a typical example. The church's sanctuary is a 5,010-square-foot open room that can accommodate 369 people. It has a wooden cathedral ceiling and wooden trusses that span its 62 foot width and support its roof.¹⁵

Difficulty of Safely Exiting Buildings that Accommodate Large Groups of People

Any building that accommodates large groups of people is difficult to exit safely in an emergency. This is especially true when panic ensues during a fire.¹⁶ For example, one hundred people lost their lives and more than 200 were injured in a 2003 fire at the Station nightclub in Rhode Island. The building did not have sprinklers, and the fire spread so quickly that smoke was visible from outside the building after only one minute. After five minutes, flames were coming through the roof. The number of people trying to get out of the building at the same time overwhelmed the exits and created a "crowd-crush" in which many people were stuck in the exit doorways. Complicating rescue efforts, major sections of the roof collapsed, preventing firefighters from accessing the inside of the building to help potential

¹² Wertman 2012 and TheIndyChannel.com 2011.

¹³ Bruck 2013 and News Channel 5.

¹⁴ McBirney 2012, 9, Merinar et al. 2005, 1, and Sanders 2014.

¹⁵ Based on information received in emails from Joe Damons, Facilities Construction Specialist, Tennessee Department of Commerce and Insurance, July 23, 2014 and September 10, 2014.

¹⁶ Cote 2003, section 13, page 29.

survivors until the entire fire was suppressed. The bodies found inside piled on top of each other suggested the panic that resulted when people were unable to escape.¹⁷

The addition of fixed seating such as church pews exacerbates the problem by making it more difficult to navigate aisles and find exits, especially when visibility is reduced by smoke. The National Fire Protection Association's Fire Protection Handbook notes that church visitors attending special events like weddings and funerals who do not use the building frequently might not be familiar with its layout and emergency procedures, increasing the risk of injury or loss of life both to themselves and those who try to help them.¹⁸

Significance of Financial and Community Losses

The financial costs of fires in places of worship can be devastating. From 2009 through 2013, there were 161 fires in places of worship in Tennessee, an average of almost three fires per month. The map on the next page shows the location of fires across the state during this period. Losses from the 99 of the 161 fires for which amounts were reported totaled almost \$15 million in property damage, an average loss of \$150,599 per fire, ranging from less than \$100 to \$1.5 million. The average reported property loss per fire in places of worship that did not have sprinklers was nearly eight times greater than in places of worship with sprinklers—\$181,664 per fire without sprinklers compared with only \$23,657 per fire with sprinklers.¹⁹

Fires in places of worship can also leave a community without an important gathering space, a distressing and emotional loss that's not easy to quantify. For church members, the loss can be like dealing with the death of a family member.²⁰ After a June 2014 fire destroyed Trinity Church of the Nazarene in Donelson, a church member said "I know it's just a building, but it's still a part of us. I just don't know. It's not good. It's rough."²¹ Congregations are not always able to rebuild quickly, disrupting the services that they provide and the activities that their buildings' host for the community.

Reducing Fire Losses in Rural Places of Worship

Effective methods for reducing the risks that fires in rural places of worship pose for community members, firefighters, and property include installing smoke detectors; staffing fire departments with more full-time firefighters; improving access to water supplies by adding tanks, reservoirs, and fire hydrants; and installing automatic sprinkler systems to provide immediate fire suppression. Although each of these methods helps limit the dangers to people and property in a fire, automatic sprinkler systems are the most effective.

¹⁷ Grosshandler et al. 2005, iii, xx, 2-2, 2-5, 3-2, 3-4, 3-6.


¹⁸ Cote 2003, section 13, page 29-30.

¹⁹ Based on data received in an email from Peyton Bullen, Program and Policy Director, Tennessee Department of Commerce and Insurance, May 27, 2014.

²⁰ WSMV.com 2012.

²¹ Flores 2014.

Map 1. Fires in Places of Worship, 2009-2013

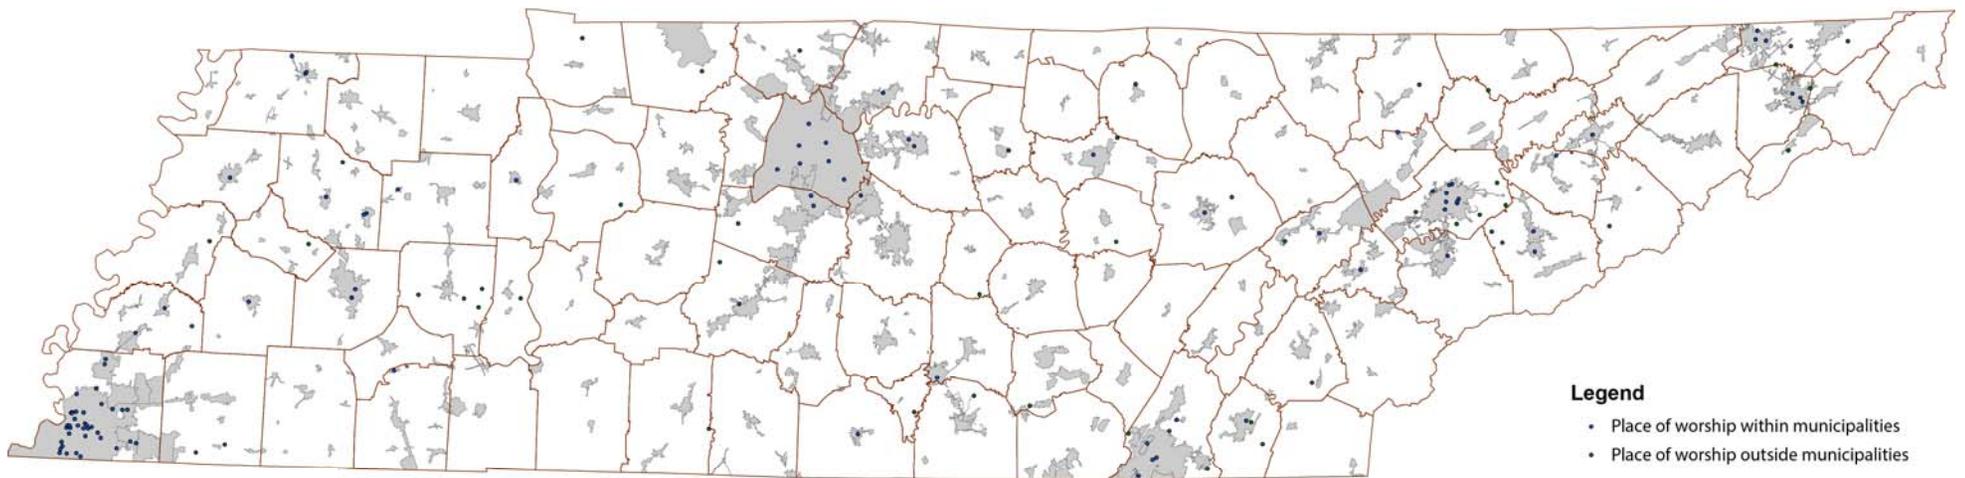

Source: Division of Fire Prevention, Tennessee Department of Commerce and Insurance, 2014.

Smoke Detectors and Remote Monitoring Systems

Properly maintained smoke detectors are critical for alerting building occupants to a fire, reducing property loss and the risk of injury and death.²² The National Fire Protection Association (NFPA) reports that from 2007 through 2011 almost two-thirds of all deaths in residential fires occurred in homes without functioning smoke detectors.²³ They are inexpensive to install and are recommended by fire professionals for all residential and non-residential buildings.²⁴

Remote monitoring systems—which can be connected to smoke detectors or automatic sprinklers—can help reduce property loss by reporting fires directly to 911 communication centers and fire departments.²⁵ Especially in rural areas with volunteer firefighters and longer response times, remote monitoring systems serve as an early warning that alerts the fire department regardless of whether someone hears the alarm at the site.

Although smoke detectors and remote monitoring systems alert building occupants and fire departments to the presence of smoke or fire, they are not a substitute for a functioning sprinkler system because they do not directly suppress and contain fires.

Training and Full-Time Firefighters

According to the Federal Emergency Management Agency, a “properly organized, staffed, and deployed fire department” is key to preventing loss of life and property damage from fires.²⁶ The US Fire Administration has found that improving firefighter training and equipment can help reduce injuries, deaths, and property damage caused by fires.²⁷ It lists better training and equipment as two factors that in addition to the near universal installation of smoke detectors and increasing installation of sprinklers have contributed to the decline in five-year fire loss rates across the United States.²⁸ Similarly, researchers at the University of Tennessee report that investments in training and equipment result in shorter response times and increase the firefighting capability of fire departments.²⁹

Nevertheless, NFPA standards give volunteer fire departments twice as long to respond to fires because they often need to alert volunteers who aren’t at the station.³⁰ According to the state fire marshal, from 2011 through 2013, the average response time in Tennessee for all-volunteer fire departments was more than double the average time for career departments—10 minutes,

²² Cote 2003, section 9, page 5 and Hamins et al. 2012, 30.

²³ Ahrens 2013, iv.

²⁴ Abdelrazek 2013, 13.

²⁵ Cote 2003, section 9, page 10.

²⁶ FEMA 2002, 26.

²⁷ Abdelrazek 2013, 12.

²⁸ US Fire Administration 2010, 8.

²⁹ Folz, et al, 2011, 34.

³⁰ Flynn 2009, 14-15, 25-26.

27 seconds, for volunteer departments versus only 4 minutes, 29 seconds, for career departments.³¹ A volunteer department that meets NFPA standards may nevertheless have much slower response times than a professional department.³² Longer response times allow fires to grow larger, making them more difficult to extinguish and increasing the risk to people and property.

Unfortunately, fire departments in rural areas are less likely to be well-funded, and many do not have the financial means to support full-time staff. In Tennessee, rural fire departments receive less public funding than suburban or urban departments and are more likely to rely on volunteers. In 2011, there were 181 Tennessee fire departments that relied on donations for 50% or more of their revenue. Most were located in unincorporated areas, and all but two were staffed entirely by volunteers.³³

Access to Adequate Water Supplies

Regardless of how a fire department is staffed or how well it's funded it must have ample sources of water. In densely populated areas, public water systems can provide sufficient water to fight fires; however, they may not be able to provide sufficient flow for fighting fires in sparsely populated areas where distribution lines must be small in order to ensure a healthy, potable water supply. Water utilities generally do not serve the most rural areas because covering the expense—including the initial cost of construction as well as the operational cost of flushing the lines—would require unaffordable water rates.³⁴

In areas without on-site water sources, fire departments rely on tanker trucks to transport water to fires. This creates logistical challenges, especially with large fires. To provide enough water to extinguish these fires, departments have to shuttle multiple trucks back and forth to off-site water sources, which are often miles away. In a typical incident, two volunteer fire departments battled for six hours to extinguish a house fire in a rural part of Rutherford County on May 10, 2014. The nearest fire hydrant was three miles away, and firefighters had to shuttle water to the site. The home was completely destroyed.³⁵

On-site storage tanks and reservoirs mitigate the challenges of transporting water in areas without a public water system by ensuring that firefighters have access to an adequate supply of water. These tanks and reservoirs can be large or small depending on a building's size and fire suppression needs. Tanks, in particular, can also be elevated, on-ground, or underground depending on the site.³⁶ Although they are expensive to install—even small tanks can cost

³¹ Data received in an email from Dennis Mulder, TFIRS Coordinator, Tennessee Department of Commerce and Insurance, September 23, 2014.

³² Bialik, 2012.

³³ Abdelrazek, 2013, 8-9.

³⁴ Telephone interview with William Dunnill, General Manager, Consolidated Utility District, Rutherford County, on October 17, 2014.

³⁵ Iaccheri, 2014.

³⁶ National Fire Protection Association 2006, section 22, page 5.

more than \$15,000³⁷—the use of tanks and reservoirs to supply water for fire suppression is common in rural areas in several other states including Arkansas and Georgia.³⁸ In areas without access to public water, tanks and reservoirs can also support sprinkler systems.

Automatic Sprinkler Systems

Automatic sprinkler systems are the best first line of defense against fires, immediately reducing the danger fires pose to the health, safety, and welfare of community members and fire fighters, as well as the damage to property caused by fires and the water used to put them out. Sprinklers address the two major challenges of fighting fires in rural areas—longer firefighter response times and limited access to water. They are activated by heat and operate before firefighters arrive, and can use water stored in on-site tanks and reservoirs.

According to the NFPA, automatic sprinklers are effective at suppressing fires in 96% of incidents in which they are activated, and they are activated in 91% of fires.³⁹ In the relatively few fires when sprinklers do not activate, it is most often because someone turns off their water supply before the fire starts or overrides the system during the fire.⁴⁰ See figure 1.

Based on NFPA investigations, fires grow more quickly when there is no sprinkler system.⁴¹ In places of worship that have sprinklers, 83% of all fires are confined to their room of origin compared with only 54% of fires in those without.⁴² From 2007 through 2011 nationwide, no injuries or loss of life occurred in fires at places of worship with sprinklers,⁴³ but fires in places of worship with and without sprinklers killed an average of two and injured an average of 19 people each year.⁴⁴ In Tennessee from 2009 through 2013, although there were no deaths in fires in places of worship, three firefighters were injured in places of worship without sprinklers.⁴⁵

³⁷ Telephone interviews with Richard Smith, Division Manager, Superior Fire Protection, October 6, 2014, Tracy Maktenieks, Branch Manager, Delta Fire Systems, October 15, 2014, and Jeff Hewitt, Corporate Engineer, American Fire Protection, October 14, 2014.

³⁸ Telephone interviews with representatives from fire marshal offices in Arizona, Arkansas, Colorado, Georgia, Idaho, Kansas, Nevada, New Mexico, North Dakota, and Utah, September 2014.

³⁹ Hall, Jr. 2013, 7.

⁴⁰ Hall, Jr. 2013, vi.

⁴¹ Cote 2003, section 10, page 188.


⁴² Hall, Jr. 2013, 26.

⁴³ Hall, Jr. 2013, 35.

⁴⁴ Campbell 2013, 9.

⁴⁵ Data received in an email from Peyton Bullen, Program and Policy Director, Tennessee Department of Commerce and Insurance, May 27, 2014.

Figure 1. Reasons that Sprinklers Fail to Operate, 2007-2011

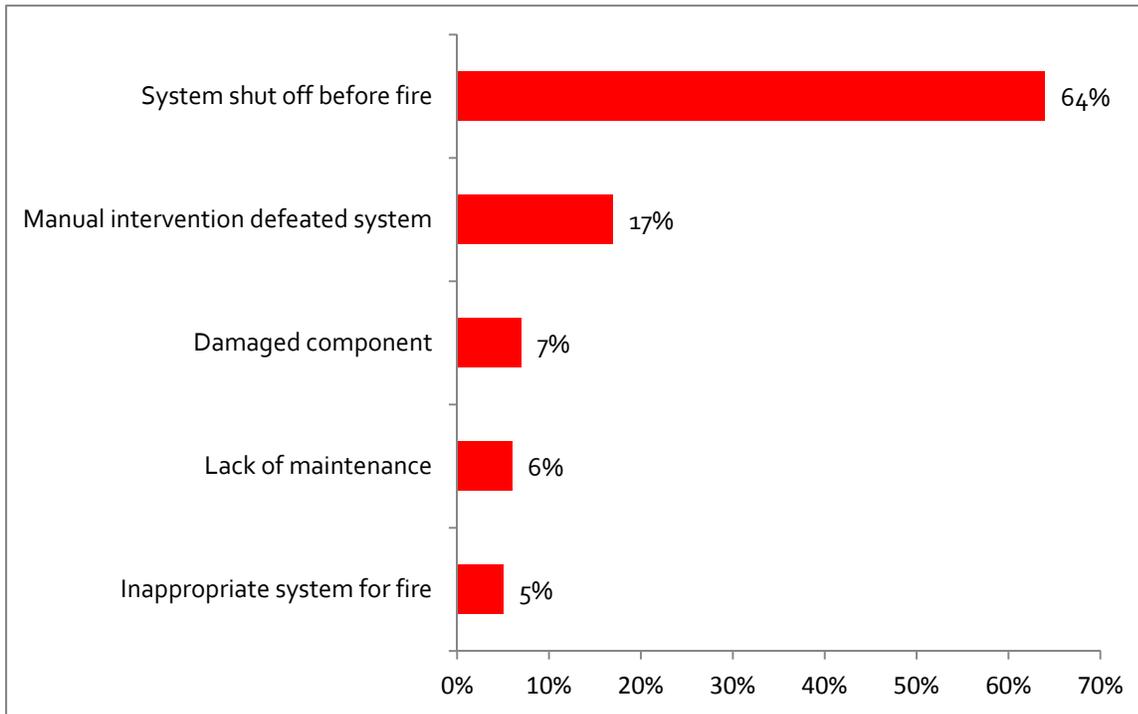

Source: Hall, Jr., John R. 2013. *U.S. Experience with Sprinklers*. Quincy, MA: National Fire Protection Association (page vi).

Sprinkler systems also reduce property damage. From 2007 through 2011 nationwide, the average loss per fire in places of worship without sprinklers was \$67,000 while the loss with sprinklers was \$18,000.⁴⁶ In Tennessee from 2009 through 2013, the average reported property loss per fire in places of worship that did not have sprinklers was nearly eight times greater than in places of worship with sprinklers—\$181,664 per fire without sprinklers compared to only \$23,657 per fire with sprinklers.⁴⁷

Sprinkler systems are designed to prevent unnecessary water damage. During fires, only the sprinklers closest to the fire will activate and operate.⁴⁸ In areas where freezing temperatures are expected, sprinkler systems are designed so that water flows through the pipes only in the event of a fire, reducing the potential for damage from frozen or broken pipes.⁴⁹

The cost of installing sprinkler systems varies from around \$1 to \$3 per square foot in residential buildings⁵⁰ and \$2 to \$3 per square foot in non-residential buildings,⁵¹ not including

⁴⁶ Campbell 2013, i.

⁴⁷ Based on data received in an email from Peyton Bullen, Program and Policy Director, Tennessee Department of Commerce and Insurance, May 27, 2014.

⁴⁸ Hall 2013, 39 and Hickey 2008, 125-126.

⁴⁹ Hickey, 2008, 103.

⁵⁰ Newport Partners 2013, 2.

the cost of installing a water supply system if one is required. The estimated cost of a sprinkler and water system, including a tank, pump, water lines, and other components, for a building similar to the Dyson Grove Baptist Church varies greatly depending on the building and site, ranging from approximately \$100,000 to more than \$200,000.⁵² The tank and pump are usually the largest portion of the total cost, while the sprinkler system might be only 10 to 40%. Some of the cost can be offset by reducing the need for fire-rated walls and other structural features that are not required when sprinklers are installed.⁵³ A reduction in insurance premiums, while possible, may not be substantial for large, infrequently-used buildings.

Tennessee Requirements for Fire Sprinklers in Places of Worship

At least since the 1980s, Tennessee's building codes have required sprinkler systems in buildings that accommodate large groups of people, including places of worship, community halls, gymnasiums, and libraries.⁵⁴ Tennessee law gives the state fire marshal authority to adopt and enforce rules establishing minimum statewide safety standards for fire prevention, fire protection, and building construction.⁵⁵ The law requires the standards to provide a "reasonable degree of safety to life and property from fire and hazards incident to the design, construction, alteration and repair of buildings or structures."⁵⁶

Tennessee's current building code is the 2006 International Building Code developed by the International Code Council.⁵⁷ It requires sprinkler systems in buildings with rooms designed to accommodate large groups of people, including places of worship, if the auditorium

1. exceeds 12,000 square feet,
2. has an occupant load⁵⁸ of 300 or more, or

⁵¹ Telephone interviews with Richard Smith, Division Manager, Superior Fire Protection, July 21, 2014, Mark Wheeler, Vice President, Arkansas Automatic Sprinklers, October 14, 2014, and Tracy Maktenieks, Branch Manager, Delta Fire Systems, October 15, 2014.

⁵² This estimate is based on information received in emails from Richard Smith, Division Manager, Superior Fire Protection, Ken Brinkley, Vice President Sales/Principal, Music City Fire Sprinkler, Rich Haffke, Project Manager, Overhead Fire Protection, and Mark Hall, Manager, Reliable Fire Protection, October 2014.

⁵³ Endthoff 1998 and Licht, no date.

⁵⁴ Telephone interview with Gary West, Assistant Commissioner, State Fire Marshal's Office, Tennessee Department of Commerce and Insurance, July 17, 2014.

⁵⁵ Tennessee Code Annotated, Section 68-120-101.

⁵⁶ Fire Prevention Division. <http://www.tn.gov/fire/fpcesect.shtml>.

⁵⁷ Rules of Tennessee Department of Commerce and Insurance Division of Fire Prevention, Chapter 0780-02-02, <http://www.tn.gov/sos/rules/0780/0780-02/0780-02-02.20100627.pdf>.

⁵⁸ Occupant load refers to the number of people who can safely occupy and exit a building. For IBC definitions, see International Code Council, *International Building Code, 2006*, 9th ed. (Country Club Hills, IL: International Code Council, 2006), Section 202,

3. is located on a floor other than the level of building exit.⁵⁹

Places of worship need to install sprinkler systems only if they meet one or more of these three conditions. The state fire marshal's office requires architects of places of assembly that accommodate 300 or more people, including places of worship, to gain its approval for building plans before beginning construction.

Proposed Legislation

Dyson Grove Baptist Church in Johnson County is an example of a place of worship in a sparsely populated, rural area without access to a public water supply and, because of its size and design, is required by the state building code to install a sprinkler system. The church congregation completed and moved into the building in 2013. The building does not have a sprinkler system, and the architect who designed it did not submit plans to the state fire marshal's office as required by law.⁶⁰ A state electrical inspector, recognizing that the plans were not approved, reported the violation to the state fire marshal, who contacted the architect and asked for a copy of the plans. Upon inspection of the plans, the fire marshal's office determined that the capacity of the auditorium was large enough to require a sprinkler system.

According to the state fire marshal's office, the church's sanctuary can accommodate 369 people, large enough to exceed the occupant load threshold in the state building code and, therefore, requires a sprinkler system. The state fire marshal is allowing the Dyson Grove congregation to continue using the church temporarily while the architect and church members develop a plan to meet the requirements of the building code. Although they could have modified the design of the building so that the sanctuary would accommodate less than 300 people, they submitted revised plans that include a sprinkler system with an underground storage tank and fire pump. The church's plans have not yet been approved.

Although they submitted new plans, the members of Dyson Grove also asked their legislators to change the law, believing that their building should be exempted from the sprinkler requirement. They argue that neither the well the church uses for its other water needs nor the stream that runs adjacent to the property is sufficient to support a sprinkler system and that connecting to the local water utility or installing a water tank and pump would be impractical and burdensome.

http://publiccodes.cyberregs.com/icod/ibc/2006f2/icod_ibc_2006f2_2_sec002.htm?bu=IC-P-2006-000001&bu2=IC-P-2006-000019.

⁵⁹ International Code Council, *International Building Code, 2006*, 903.2.1.3.

⁶⁰ The Codes Enforcement Section of the Fire Prevention Division forwarded the architect's signed letter of competency to the Board of Architectural and Engineering Examiners, who reviewed the architect's qualifications and the project and imposed a civil penalty against the architect for practicing outside his area of competence; the case is pending.

In response to Dyson Grove’s concerns, Representative Timothy Hill introduced House Bill 1649 (Senate Bill 1749 by Niceley),⁶¹ which was sent to the Commission by the House Local Government Subcommittee. If passed, the bill would amend current law to exempt from state laws and regulations requiring places of assembly to have fire protection sprinkler systems

- single-story places of worship
- located in unincorporated areas
- as long as they
 - have a capacity of no more than 400 persons;
 - do not have a water supply located on the property;
 - have a minimum of two exits, plus one additional exit for every 2,500 square feet or portion thereof over 4,500 square feet;
 - have a fire alarm system;
 - have fixed seating for at least 250 persons; and
 - have been built on or after July 1, 2012.

Engineers, architects, and fire officials interviewed by commission staff opposed the bill, citing the threat that it posed to the health, safety, and welfare of community members and firefighters. The Tennessee Fire Chief’s Association opposed the bill in its entirety because the codes provide the minimum standard of safety.⁶² The Tennessee Society of Professional Engineers and the American Council of Engineering Companies of Tennessee both opposed the bill, saying that their main priority is the health, safety, and welfare of the public. They said people visiting churches for special events would not necessarily know how to exit the building in a fire, increasing the risk for community members and firefighters.⁶³ American Institute of Architects Tennessee noted that churches accommodate large numbers of people, making them particularly dangerous in the event of a fire in remote rural areas; sprinklers increase the safety of people using these buildings as well as firefighters.⁶⁴

Exceptions for Places of Worship in Other States

As shown in the following table, only eight states have modified the model building codes’ automatic fire sprinkler requirements for places of worship. Two make the requirement more stringent than the standard in the model code. For example, Delaware lowered the square footage threshold for installing sprinklers from 12,000 to 10,000 square feet if a water system is

⁶¹ See appendix.

⁶² Telephone interview with Roger Robinson, President, Tennessee Fire Chief’s Association, June 9, 2014.

⁶³ Telephone interview with Candy Toler, Executive Director, Tennessee Society of Professional Engineers and American Council of Engineering Companies of Tennessee, May 6, 2014.

⁶⁴ Telephone interview with Trey Wheeler, Vice President of AIA Tennessee and Head of Government Relations Committee, May 14, 2014.

available and stipulated that individual rooms may not exceed 10,000 square feet in buildings where no private or public water distribution system is available. Similarly, Massachusetts lowered the square footage threshold from 12,000 to 5,000 square feet. In these two states, sprinklers are required in smaller auditoriums than in Tennessee.

States with Exceptions to Fire Sprinkler Requirements for Places of Worship

State	Model Codes Adopted	Exception
More stringent than Model Code		
Delaware	NFPA 101	Reduced square footage threshold from 12,000 to 10,000 square feet.
Massachusetts	2009 IBC*	Reduced square footage threshold from 12,000 to 5,000 square feet.
Less Stringent than Model Code		
Florida	2009 IBC and 2009 NFPA 101	Increased occupant load threshold from zero to 100.
Indiana	2006 IBC	Reduced square footage threshold from 12,000 to 7,000 square feet and removed occupant load threshold.
Kentucky	2012 IBC	Removed occupant load threshold and level of exit discharge requirement.
North Carolina	2009 IBC	Removed occupant load threshold.
Ohio	2009 IBC	Removed square footage and occupant load threshold.
Virginia	2012 IBC	Removed occupant load threshold.

Source: Information gathered from state fire marshal’s offices and building codes departments in each state.

*International Building Code

Six states—Florida, Indiana, Kentucky, North Carolina, Ohio, and Virginia—have adopted various exceptions for places of worship that make the sprinkler requirement less stringent. Each of these states has chosen either to remove or increase the occupant load threshold. Ohio also removed the square footage threshold, and Kentucky made an exception for places of worship in which the auditorium is located on a floor other than the level of exit from the building. Representatives from the building code department or state fire marshal’s office in five of these six states cited the interests of rural places of worship without access to water as the reason for creating an exception to the sprinkler requirements. Florida alone specifically

acted to exempt fellowship halls that lack fixed seating and is currently reviewing whether or not to remove its exception, returning to the original code.

Gaps in national fire incident data limit the ability to determine the effects of the exceptions in each state. Because fire departments report data voluntarily and participation rates vary, data quality and quantity are not necessarily consistent, making it difficult to compare fires before and after changes were made to the codes in different states.

References

- Abdelrazek, Reem, Catherine Corley, Cliff Lippard, Lynnis Roehrich-Patrick. 2013. *Fire Service in Tennessee*. Tennessee Advisory Commission on Intergovernmental Relations.
- Ahrens, M. 2013. *Home Structure Fires*. Quincy, MA: National Fire Protection Agency.
- Associated Press. "Fire Destroys Rural Church in Central Indiana," *Washington Times*, January 24, 2014. <http://www.washingtontimes.com/news/2014/jan/24/fire-destroys-rural-church-in-central-indiana/> (accessed September 11, 2014).
- Bialik, Carl. "The Fire Countdown Clock." *The Wall Street Journal*. April 20, 2012. <http://blogs.wsj.com/numbers/the-fire-countdown-clock-1134/> (accessed September 25, 2014)
- Bruck, Julia. "3-alarm fire destroys Donelson church." WSMV.com, July 14, 2013. <http://www.wsmv.com/story/22604540/firefighters-respond-to-2-alarm-church-fire-near-donelson> (accessed September 15, 2014).
- Campbell, Richard. 2013. *U.S. Structure Fires in Religious and Funeral Properties*. Quincy, MA: National Fire Protection Association.
- Code Consultants, Inc. 2012. *Fire Flow Water Consumption in Sprinklered and Unsprinklered Buildings: An Assessment of Community Impacts*. Quincy, MA: National Fire Protection Agency, Fire Protection Research Foundation.
- Cote, Arthur E. 2003. *Fire Protection Handbook*. Volume 2, 19th Edition. National Fire Protection Association. Sections 9, 10, and 13, 29-39.
- Endthoff, Gene B. 1998. "The Sprinkler Trade-Off Concept." National Fire Protection Association. <http://www.nfsabackend.com/info/codes/CCWINTER98.html> (accessed September 25, 2014).
- FEMA. 2002. *America at Risk: America Burning Recommissioned*. US Department of Homeland Security.
- Fire Prevention Division. "Codes Enforcement Section – Information." Tennessee Department of Commerce and Insurance. <http://www.tn.gov/fire/fpcesect.shtml> (accessed August 20, 2014).
- Flores, Adrienne. "South Nashville Church Catches Fire for 2nd Time in 2 Years." WSMV.com, June 19, 2014. <http://www.wsmv.com/story/25699784/south-nashville-church-catches-fire-for-2nd-time-in-2-years> (accessed September 2, 2014).
- Flynn, Jennifer D. 2009. *Fire Service Performance Measures*. Quincy, MA: National Fire Protection Agency, Fire Analysis and Research Division.
- Folz, David H., Chris Shults, Mike Meyers, Frances Adams-O'Brien, Leah Festa, and Gary L. West. 2011. *An analysis of civilian residential fire deaths in Tennessee, 2002-2010*. Knoxville: University of Tennessee.

- Gamache, Sharon, John R. Hall, Jr., Marty Ahrens, Geri Penney, and Ed Kirtley. 2007. *Mitigation of the Rural Fire Problem: Strategies Based on Original Research and Adaptation of Existing Best Practices*. US Fire Administration. FEMA.
- Grosshandler, William, Nelson Bryner, Daniel Madrzykowski, Kenneth Kuntz. 2005. *Report of the Technical Investigation of the Station Nightclub Fire*. National Institute of Standards and Technology, US Department of Commerce.
- Hall, Jr., John R. 2013. *U.S. Experience with Sprinklers*. Quincy, MA: National Fire Protection Association.
- Hamins, Anthony, Jason Averill, Nelson Bryner, Richard Gann, David Butry, Rick Davis, Francine Amon, et al. 2012. *Reducing the risk of fire in buildings and communities: A strategic roadmap to guide and prioritize research*. National Institute of Standards and Technology, US Department of Commerce.
- Hickey, Harry E. 2008. *Water Supply Systems and Evaluation Methods, Volume 1: Water Supply System Concepts*. US Fire Administration Federal Emergency Management Agency.
- Iaccheri, John. 2014. "Family of 10 Escapes House Fire." <http://murfreesboro.com/family-of-10-escapes-house-fire/> (accessed October 17, 2014).
- International Code Council, Inc. "About ICC." <http://www.iccsafe.org/abouticc/Pages/default.aspx> (accessed August 19, 2014).
- International Code Council, Inc. 2006. *International Building Code*. 9th Edition.
- Lauer, Kevin J. 2004. *Tennessee County Fire Handbook*. University of Tennessee County Technical Assistance Service.
- Licht, Richard. "Balancing Active and Passive Fire Protection Systems in the Building Codes." http://www.firestop.org/uploads/2/4/5/4/24544763/balancing_active_and_passive_fire_protection_systems.pdf (accessed September 25, 2014).
- Lutz, Virginia. "Volunteer Chief Dies and Two Fire Fighters are Injured by a Collapsing Church Facade – Tennessee." *Death in the Line of Duty*, National Institute of Occupational Safety and Health, January 13, 2006. <http://www.cdc.gov/niosh/fire/pdfs/face200437.pdf> (accessed August 15, 2014).
- McBirney, Matthew. "Reducing the Risk of Firefighter Deaths and Injuries Due to Structural Collapse in the City of Aurora, Ohio," University of Cincinnati College of Engineering and Science - Fire Science Department, March 10, 2012. <http://ceas.uc.edu/content/dam/aero/docs/fire/Papers/Reducing%20Risk%20Of%20Firefighter%20Death%20and%20Injuries%20Due%20To%20Structural%20Collapse.pdf> (accessed on September 11, 2014).
- Merinar, Timothy R., Richard W. Braddee, Frank Washenitz, II, Tom Mezzanotte, Vincent Dunn, and Frank Brannigan, "Preventing Injuries and Deaths of Fire Fighters due to Truss

System Failures." April 2005. National Institute for Occupational Safety and Health. <http://www.cdc.gov/niosh/docs/2005-132/pdfs/2005-132.pdf> (accessed September 11, 2014).

National Fire Protection Association. 2006. *Standard for Water Tanks for Private Fire Protection, National Fire Codes*. volume 2, section 22.

Newport Partners. 2013. *Home Fire Sprinkler Cost Assessment – 2013, Final Report*. Quincy, MA: Fire Protection Research Foundation.

News Channel 5. "Donelson (Tennessee) Church Destroyed by Three-Alarm Fire." June 17, 2013. <http://ocl.org/donelson-tennessee-church-destroyed-by-three-alarm-fire/> (accessed September 15, 2014).

Roehrich-Patrick, Lynnise, Cliff Lippard, Ben Smith, Catherine Corley, Michael Mount, and Teresa Gibson. 2014. *Ensuring Fair and Equitable Water and Wastewater Rates for Non-resident Customers of City Utilities*. Tennessee Advisory Commission on Intergovernmental Relations.

Rules of Tennessee Department of Commerce and Insurance Division of Fire Prevention. Chapter 0780-02-02. Codes and Standards. <http://www.tn.gov/sos/rules/0780/0780-02/0780-02-02.20100627.pdf> (accessed September 25, 2014).

Sanders, Russ. "Firefighter Safety and the Code and Standard Development Process." Public Entity Risk Institute. http://www.riskinstitute.org/peri/component/option,com_bookmarks/Itemid,44/catid,36/navst art,4/task_detail/mode,0/id,735/search,*/ (accessed September 11, 2014).

Tennessee Society of Professional Engineers and American Council of Engineering Companies of Tennessee, "Fire Sprinkler Requirements," issue brief, April 6, 2014.

TheIndyChannel.com. "Indiana Firefighter Killed in Roof Collapse," *Firehouse World*. June 15, 2011. <http://www.firehouse.com/news/10462451/indiana-firefighter-killed-in-roof-collapse> (accessed November 4, 2014).

US Fire Administration/National Fire Data Center. 2010. *A Profile of Fire in the United States, 2003-2007*. 15th Edition. FEMA. https://www.usfa.fema.gov/downloads/pdf/statistics/profile_fitus_15th.pdf (accessed November 4, 2014).

US Fire Administration, "Nonresidential Building Fire Trends (2007-2011)". US Department of Homeland Security. http://www.usfa.fema.gov/downloads/pdf/statistics/nonres_bldg_fire_estimates.pdf (accessed October 17, 2014).

US Fire Administration. 2014. "On-Duty Firefighter Fatalities 1977-2012." Federal Emergency Management Agency. http://www.usfa.fema.gov/fireservice/firefighter_health_safety/firefighter_fatalities/reports/yearly_fatalities.shtm (accessed August 19, 2014).

Vaughn, Ellen and Jim Turner. 2013. *The Value and Impact of Building Codes*. Washington, D.C.: Environmental and Energy Study Institute.

Wertman, Stacy C. 2012. "Career Fire Fighter Dies in Church Fire Following Roof Collapse – Indiana," *Death in the Line of Duty*, National Institute of Occupational Safety and Health. <http://www.cdc.gov/niosh/fire/reports/face201114.html> (accessed September 10, 2014).

WSMV.com. "Electrical Problem Likely Caused Lebanon Church Fire." December 16, 2012. <http://www.wsmv.com/story/20128968/fire-destroys-lebanon-church> (accessed August 15, 2014).

WLKY.com. "Fire Destroys Rural Church in Central Indiana." January 24, 2014. <http://www.wlky.com/news/local-news/indiana-news/fire-destroys-rural-church-in-central-indiana/24096550> (accessed September 11, 2014).

Persons Interviewed

Brad Bain, Vice President of Community
Hazard Mitigation
Verisk Analytics
Insurance Services Offices, Inc.

Chris Bainbridge, Director
Codes Enforcement Section
Fire Prevention Division
Tennessee Department of Commerce and
Insurance

Chuck Bidek, Chief Executive Officer
Insurors of Tennessee

Ted Black, Chief Deputy State Fire Marshal
Office of the State Fire Marshal
Utah Department of Public Safety

Ken Brinkley, Vice President Sales,
Principal
Music City Fire Sprinkler, LLC

Peyton Bullen, Director
Policy and Programs
Fire Prevention Division
Tennessee Department of Commerce and
Insurance

James Bundy, Architect and Owner
Bundy Architecture and Engineering, Inc.

Ron Burton, Independent Contractor
Building Owners and Managers Association

Greg Carrell, Acting Fire Marshal
Office of the State Fire Marshal
Missouri Department of Public Safety

Ashley Cates, Executive Director
American Institute of Architects

Steve Clarke, Assistant Vice President of
Government Relations
Verisk Analytics
Insurance Services Offices, Inc.

Mel Cosgrove, Senior Regional Manager
State and Local Government Relations
International Code Council

James Cothron, Executive Director
Board of Architectural and Engineering
Examiners
Tennessee Department of Commerce and
Insurance

Joe Damons, Facilities Construction
Specialist III
Codes Enforcement Section
Fire Prevention Division
Tennessee Department of Commerce and
Insurance

Randy Davis, Executive Director
Tennessee Baptist Convention

Vicki Davis
Chattanooga Chapter
Building Owners and Managers Association

Randy Deshon, Fire Prevention Supervisor
Kansas Office of the State Fire Marshal

John Duncan, Manager
Property and Casualty
Insurance Division
Tennessee Department of Commerce and
Insurance

Bill Dunnill, General Manager
Consolidated Utility District, Rutherford
County, Tennessee

Fred Durham, Assistant State Fire Marshal
Office of the State Fire Marshal
Arizona Department of Fire, Building and
Life Safety

Nicole Dutton, Librarian and Records
Management Analyst
National Fire Protection Association

Leigh Ferguson, Assistant General Counsel
Tennessee Department of Commerce and
Insurance

Dave Finger, Director
Government Relations
National Volunteer Fire Council

Don Finocchio, Code Analyst
Department of Fire Services
Massachusetts Office of Public Safety and
Security

Rob Geislinger, Section Chief
Fire Life Safety Section
Colorado Division of Fire Prevention and
Control

Mary Beth Gribble, Legislative Liaison
Tennessee Department of Commerce and
Insurance

Rich Haffke, Estimator, Project Manager
Overhead Fire Protection, Inc.

Mark Hall, Manager
Reliable Fire Protection, Inc.

Jason Hardage, Sales Manager Southeast
USA Tank

Jeff Hewitt, Corporate Engineer
American Fire Protection, Inc.

Timothy Hill, State Representative
District 3

Vernon Hodge, Technical and Code
Development Specialist
State Building Codes Office
Virginia Division of Building and Fire
Regulation

Brian Hoffmeister, Director of Policy
Analysis
Insurance Division
Tennessee Department of Commerce and
Insurance

Bob James, Program Manager
Fire Service Outreach
Underwriters Laboratories

Dan Johnson, Fire Marshal
Town of Farragut
First Vice President
Eastern Division Representative
Tennessee Fire Safety Inspectors
Association

Raymond Keene, State Electrical Inspector
Tennessee Department of Commerce and
Insurance

Steve Keys, Deputy Administrator of
Operations
Idaho Division of Building Safety

Kevin Lauer, Fire Management Consultant
University of Tennessee
County Technical Assistance Service

Denise Lawrence, Legislative Director
Tennessee Department of Commerce and
Insurance

R. T. Leicht, Chief Fire Protection Specialist
Office of State Fire Marshal
Delaware State Fire Prevention
Commission

Tracy Maktenieks, Branch Manager
Delta Fire Systems, Inc.

Larry McKenna, Fire Protection Engineer
U S Fire Administration

Don Miller, President
American institute of Architects

Peter Mulvihill, State Fire Marshal
State Fire Marshal Division
Nevada Department of Public Safety

Mike Murphy, Attorney
Murphy and Associates

Ron Murphy, District Manager
Dry Run Utility District

Frank Niceley, State Senator
District 8

Deborah Ohler, Staff Engineer
Board of Building Standards Code Section
Ohio Department of Commerce

Eddie Plunkett, President
Tennessee Building Officials Association

Mike Pfeiffer, Deputy Senior Vice President
Technical Services
International Code Council

Roger Robinson, President
Tennessee Fire Chiefs Association

Randy Safer, Regional Director
Southern Region
National Fire Protection Association

Holly Salmons, Senior Associate
Johnson Poss Government Relations

Jim Shull, Fire Chief
Neva Volunteer Fire Department

Ken Sisk, Deputy State Fire Marshal
Fire Marshal Division
North Dakota Attorney General

Richard Smith, Division Manager
Superior Fire Prevention

Mara Snyder, Director
Legal and Code Services
Indiana Department of Homeland Security
Fire Prevention and Building Safety
Commission

Dale Spicer, Technical Advisor
Division of Building Codes Enforcement
Kentucky Department of Housing,
Buildings, and Construction

John Standefer, State Fire Marshal
State Fire Marshal's Office
New Mexico Public Regulation Commission

Terri Stemen, Assistant Manager
Customer Service
Brotherhood Mutual Insurance Company

Richard Strickland, Chief Fire Code
Consultant
Office of State Fire Marshal
North Carolina Department of Insurance

Karl Thompson, Engineer, IV
Bureau of Fire Prevention,
Florida Division of State Fire Marshal

Candy Toler, Executive Director
Tennessee Society of Professional
Engineers

American Council of Engineering
Companies of Tennessee

Chris Vannoy, Church Member
Dyson Grove Baptist Church

Wayne Waggoner, Executive Director
Tennessee Fire Sprinkler Contractors
Association

Rich Walke
Code Authority
Regulatory Services Department
Underwriters Laboratories

Chuck Walker, Fire Chief
Ashland City, Tennessee

Jason Webb, Director of Inspection, Testing
and Maintenance
National Fire Sprinkler Association

Gary West, Assistant Commissioner
Fire Prevention Division
Tennessee Department of Commerce and
Insurance

Mark Wheeler, Vice President Sales
Arkansas Automatic Sprinklers, Inc.

Trey Wheeler, Vice-President and Head of
Government Relations Committee
American Institute of Architects

Tommy White, Fire Marshal
Eastern Division Representative
Tennessee Fire Safety Inspectors
Association

Lindsey Williams, State Fire Marshal and
Division Commander
State Fire Marshal's Office
Arkansas Regulatory & Building Operations
Services

Bill Young, Executive Vice President
Associated General Contractors of
Tennessee

Persons Contacted

Ron Anstey, Section Chief
Engineering and Plans Review
State Fire Marshal's Office

Eric Beohm, Fire Safety Engineer
State Fire Marshal's Office
Georgia Office of Insurance and Safety Fire
Commissioner

Clint Berthay, Northeast District
Fire Codes Division
State Fire Marshal's Office
Mississippi Insurance Department

Bill Bischof, Interim Deputy Section Chief -
Building Code
Fire Life Safety Section
Colorado Division of Fire Prevention and
Control

Ted Black, Chief Deputy State Fire Marshal
Office of the State Fire Marshal
Utah Department of Public Safety

David Blackwell II, Chief Engineer
Licensing and Regulation
Office of State Fire Marshal
South Carolina Department of Labor

Chuck Boyte, President
Middle Tennessee Chapter
Society of Fire Protection Engineers

Terry Brouwer, Fire and Life Safety
Supervisor
Office of State Fire Marshal
Division of Construction Services
Connecticut Department of Administrative
Services

Greg Carrell, Acting Fire Marshal
Office of the State Fire Marshal
Missouri Department of Public Safety

Pat Clinch, Deputy State Fire Marshal
Fire Prevention and Investigation Section
Montana Department of Justice

N. Michael Collier, Senior Building
Construction Engineer
Division of Building Standards and Codes
Office of Planning and Development
New York Department of State

Clyde Cummings, Plans Reviewer and
Inspector
Office of the State Fire Marshal
West Virginia Fire Commission

Charles Curtis, Assistant Chief
Bureau of Construction Codes
Michigan Department of Licensing and
Regulatory Affairs

Sheldon Dacus, Vice President
Security Fire Protection

Bill Degnan, Director
Division of Fire Safety
New Hampshire Department of Safety

Lawrence "Joe" Delaune, Chief Architect
Office of State Fire Marshal
Louisiana Department of Public Safety and
Corrections

Randy Deshon, Fire Prevention Supervisor
Kansas Office of the State Fire Marshal

Jim Dunlap, President
Fire Protection Systems

Fred Durham, Assistant State Fire Marshal
Office of the State Fire Marshal
Arizona Department of Fire, Building and
Life Safety

Don Finocchio, Code Analyst
Department of Fire Services
Massachusetts Office of Public Safety and
Security

Rob Geislinger, Section Chief
Fire Life Safety Section
Colorado Division of Fire Prevention and
Control

Kathy Hehny, Executive Assistant
Oklahoma Uniform Building Code
Commission

Doug Hinkle, Chief Deputy Fire Marshal
State Fire Marshal's Office
South Dakota Department of Public Safety

Vernon Hodge, Technical and Code
Development Specialist
State Building Codes Office
Division of Building and Fire Regulation
Virginia Department of Housing and
Community Development

Doug Hohbein, Chief Plans Examiner
Nebraska State Fire Marshal's Office

Morgan Hurley, Technical Director
Society of Fire Protection Engineers

Edward "Ted" Itchon, Fire Protection
Engineer
Building Services Division
Community and Economic Development
Salt Lake City Corporation

Steve Keys, Deputy Administrator of
Operations
Idaho Division of Building Safety

James King, State Office Representative
Division of Building Standards and Codes
Office of Planning and Development
New York Department of State

Ed Landon, Director
Codes Administration
Maryland Department of Housing and
Community Development

Jerry Leach, Public Safety Inspector II
Office of the State Fire Marshal
Maine Department of Public Safety

R. T. Leicht, Chief Fire Protection Specialist
Office of State Fire Marshal
Delaware State Fire Prevention
Commission

Jack Leyden, State Building Code
Commissioner
Contractors' Registration Board
Rhode Island Building Code Commission

Mark Lockerman, Director
State Fire Marshal's Office
Texas Department of Insurance

John Ludi, Deputy State Fire Marshal
Code Enforcement Bureau
State Fire Marshal's Office
New Mexico Public Regulation Commission

Joe Marchioni, Uniform Construction Code
Administrator
Pennsylvania Department of Labor and
Industry

Joanne McCaughan, Code Specialist
State Building Code Council
Washington Department of Enterprise
Services

Scott McLellan, Director
Construction Codes and Licensing Division
Minnesota Department of Labor and
Industry

Steve Mills, Director of Codes
City of Hendersonville
Tennessee Building Officials Association

Judson Mobbs, Fire Safety Supervisor
State Fire Marshal's Office
Georgia Office of Insurance and Safety Fire
Commissioner

Angele Morcos, Senior Staff Engineer
Engineering Standards
FM Global

Peter Mulvihill, State Fire Marshal
State Fire Marshal Division
Nevada Department of Public Safety

Doug Myers, Deputy Fire Marshal
Fire Marshal Division
North Dakota Attorney General

Karl Nagatori, Fire Inspector
State Fire Council and Building Code
Council
Hawaii Department of Accounting and
General Services

Lloyd Nakano, Assistant State Fire Marshal
Fire and Life Safety
Alaska Department of Public Safety

Mike Nearman, Deputy Executive Director
California Building Standards Commission

Deborah Ohler, Staff Engineer
Board of Building Standards Code Section
Ohio Department of Commerce

Robert Patterson, Deputy Director
Office of the State Fire Marshal
Division of Fire Safety
Vermont Department of Public Safety

Edward Paulk, State Fire Marshal
State Fire Marshal's Office
Alabama Department of Insurance

Steven Regoli, Architect Administrator
Board of Building Standards Code Section
Ohio Department of Commerce

Kevin Reinertson, Division Chief
Codes Development & Analysis
Office of the State Fire Marshal
California Department of Forestry and Fire
Protection

Ed Ruckriegel, Fire Marshal
Fire Department
City of Madison, Wisconsin

Ken Sisk, Deputy State Fire Marshal
Fire Marshal Division
North Dakota Attorney General

Mara Snyder, Director
Legal and Code Services
Indiana Department of Homeland Security
Fire Prevention and Building Safety
Commission

Dale Spicer, Technical Advisor
Division of Building Codes Enforcement
Kentucky Department of Housing,
Buildings, and Construction

John Standefer, State Fire Marshal
State Fire Marshal's Office
New Mexico Public Regulation Commission

Karl Thompson, Engineer, IV
Bureau of Fire Prevention,
Florida Division of State Fire Marshal

Bill Steffenhagen, Consultant
Fire Protection Associates, Inc.

Richard Strickland, Chief Fire Code
Consultant
Office of State Fire Marshal
North Carolina Department of Insurance

Aeron Teverbaugh, Policy Analyst
Policy and Technical Services
Oregon Building Codes Division

Ljerka Vasiljevic, Senior Design
Construction Engineer
State Fire Marshal's Office
Iowa Department of Public Safety

Paula Veltum, Director
Division of Industry Services
Wisconsin Department of Safety and
Professional Services

Patricia Westerholm, Plan Review Analyst
State Fire Marshal's Office
Wyoming Department of Fire Prevention
and Electrical Safety

Michael Whalen, Construction and Fire
Subcode Official
Code Assistance Unit
New Jersey Department of Community
Affairs

David White, Program Manager
Building Codes Bureau
Business Standards Division
Montana Department of Labor & Industry

Lindsey Williams, State Fire Marshal and
Division Commander
State Fire Marshal's Office
Arkansas Regulatory & Building Operations
Services

Kenneth Wood, Fire Protection Engineer,
Director
Technical Services Division
Illinois Office of the State Fire Marshal

Robin Zevotek, Research Engineer III
UL Firefighter Safety Research Institute

Appendix

SENATE BILL 1749
By Niceley

HOUSE BILL 1649

By Hill T

AN ACT to amend Tennessee Code Annotated, Title 56, Chapter 19; Title 62, Chapter 32; Title 68, Chapter 102 and Title 68, Chapter 120, relative to fire sprinklers in places of worship.

BE IT ENACTED BY THE GENERAL ASSEMBLY OF THE STATE OF TENNESSEE:

SECTION 1. Tennessee Code Annotated, Title 68, Chapter 102, Part 1, is amended by adding the following language as a new section:

68-102-154.

(a) For purposes of this section, unless the context otherwise requires:

(1) "Building code" means any nationally recognized code that has been adopted by reference by the state or local government, or any code that has been implemented by ordinance or resolution by a local government;

(2) "Place of worship" means any building that is:

(A) Approved, or meeting criteria for approval, by the state board of equalization for property tax exemption pursuant to § 67-5-212, based on ownership and use of the building by a religious institution; and

(B) Utilized on a regular basis by the religious institution as the site of congregational services, rites, or activities communally undertaken for the purpose of worship; and

(2) "Water supply" means water supplied by a public or private utility water main, gravity tank, pressure tank, reservoir, or well.

(b) Notwithstanding any law, rule, building code, or fire safety standard to the contrary, a fire protection sprinkler system shall not be required in a single-story building located in an unincorporated area that meets all of the following requirements:

HB1649
008131
-1-

- (1) Is a place of worship;
- (2) Has a capacity of no more than four hundred (400) persons;
- (3) Does not have a water supply located on the property;
- (4) Has a minimum of two (2) exits, plus one (1) additional exit for every two thousand five hundred square feet (2,500 sq. ft.) or portion thereof over four thousand five hundred square feet (4,500 sq. ft.);
- (5) Has a fire alarm system; and
- (6) Has fixed seating for at least two hundred fifty (250) persons.

(c) It is the intent of the general assembly that this section shall apply retroactively to any place of worship built on or after July 1, 2012.

SECTION 2. This act shall take effect upon becoming a law, the public welfare requiring

it.