

The image shows two men in white hard hats and high-visibility yellow and orange safety jackets standing on a metal platform at a water treatment facility. They are looking at a laptop computer. In the background, there are concrete structures, pipes, and a clear blue sky.

TN

Department of
**Environment &
Conservation**

Tennessee Operator Certification Formula Manual

Water Treatment Formulas & Conversions

Prepared by the Fleming Training Center



About This Manual

This publication is provided by the Tennessee Department of Environment and Conservation (TDEC), Division of Water Resources (DWR), as an official resource for examinees participating in the State of Tennessee's operator certification program. It may be used during certification exams and is intended to support operators in understanding and applying essential mathematical formulas and conversions in the field.

This manual was collaboratively developed and reviewed by:

- **Fleming Training Center (FTC)** – content development and formatting
- **Water Professionals International (WPI)** – foundational formula reference materials
- **Tennessee Association of Utility Districts (TAUD)** – editorial review and industry input

This resource is intended to reflect Tennessee's commitment to operator preparedness and professional excellence. While based on national standards, the formatting and presentation have been tailored to meet the needs of Tennessee operators and exam settings.

Document Revision History

<u>Revision</u>	<u>Date</u>	<u>Brief Summary of Change</u>
0	10/2025	Initial Issue
1	1/2026	Revised Chemical Feed Pump, mL/min
1	1/2026	Added Force to Power section
1	1/2026	Added conversion ft ² to m ²

Water Treatment Formulas & Conversions

Table of Contents

<u>Subject</u>	<u>Page Number</u>
Area	2
Alkalinity Relationships	9
Chemical Feeders	9
Chlorination	6
Circumference and Perimeter	2
Coagulation/Flocculation	7
Common Abbreviations	11
Distribution Calculations	9
Dosage	3
Filtration	8
Flow	3
Flow Conversion Chart	13
Laboratory Calculations	10
Metric Conversion Chart	12
Pie Wheels	14
Pounds	3
Power	4
Pumps and Motors	4-5
Sedimentation	7
Solution Preparation	8
Unit Conversions Factors	12
Velocity	2
Volume	2
Well Formulas	6

Water Treatment Formulas & Conversions

Circumference and Perimeter

Circumference of a Circle = (3.14)(Diameter)

Perimeter, ft = (2)(Length, ft) + (2)(Width, ft)

Area

Area of a Circle*, ft² = (0.785)(Diameter, ft)²

Area of a Circle, ft² = (3.14)(Radius, ft)²

Area of a Rectangle*, ft² = (Length, ft)(Width, ft)

Area of a Right Triangle*, ft² = $\frac{[(\text{Base, ft})(\text{Height, ft})]}{2}$

Lateral Surface Area of a Cone, ft² = (3.14)(Radius, ft)($\sqrt{(\text{Radius, ft})^2 + (\text{Height, ft})^2}$)

Total Surface Area of a Cone, ft² = (3.14)(Radius, ft) (Radius, ft + $\sqrt{(\text{Radius, ft})^2 + (\text{Height, ft})^2}$)

Total Exterior Surface Area of a Cylinder, ft² =
(end #1 SA, ft²) + (end #2 SA, ft²) + [(3.14)(Diameter, ft)(Height, ft)]
Where SA = Surface Area of a Circle

Volume

Volume of a Cone*, ft³ = (1/3)(0.785)(Diameter, ft)²(Height, ft)

Volume of a Cylinder*, ft³ = (0.785)(Diameter, ft)²(Height, ft)

Volume of a Rectangular Tank*, ft³ = (Length, ft)(Width, ft)(Height, ft)

Volume, gallons = (Volume, ft³) (7.48 gal/ft³)

Velocity

Velocity, ft/sec = $\frac{\text{Distance, ft}}{\text{Time, sec}}$

Velocity, ft/sec = $\frac{\text{Flow Rate, ft}^3/\text{sec}}{\text{Area, ft}^2}$

*Pie Wheel Format for this equation is available at the end of this document

Water Treatment Formulas & Conversions

Flow

$$\text{Flow}^*, \text{ ft}^3/\text{sec} = (\text{Area, ft}^2)(\text{Velocity, ft/sec})$$

$$\text{Flow Through a Channel, ft}^3/\text{sec} = (\text{Width, ft})(\text{Depth, ft})(\text{Velocity, ft/sec})$$

$$\text{Flow Through a Full Pipeline, ft}^3/\text{sec} = (0.785)(\text{Diameter, ft})^2(\text{Velocity, ft/sec})$$

$$\text{Flow Through a Cone, ft}^3/\text{sec} = (1/3)(0.785)(\text{Diameter, ft})^2(\text{Velocity, ft/sec})$$

Pounds

$$\text{Mass}^*, \text{ lb} = (\text{Concentration, mg/L})(\text{Volume, MG})(8.34 \text{ lb/gal})$$

$$\text{Mass, lb} = \frac{(\text{Concentration, mg/L})(\text{Volume, MG})(8.34 \text{ lb/gal})}{\text{Chemical Purity, \% expressed as a decimal}}$$

$$\text{Loading Rate}^*, \text{ lb/day} = (\text{Concentration, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})$$

$$\text{Feed Rate}^*, \text{ lb/day} = \frac{(\text{Dosage, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})}{\text{Chemical Purity, \% expressed as a decimal}}$$

$$\text{Fluoride Feed Rate, lb/day} = \frac{(\text{Dosage, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})}{(\text{Available Fluoride Ion, \% expressed as a decimal})(\text{Purity, \% expressed as a decimal})}$$

$$\text{Fluoride Saturator Feed Rate, gpm} = \frac{(\text{Plant Capacity, gpm})(\text{Dosage, mg/L})}{18,000 \text{ mg/L}}$$

Dosage

$$\text{Dosage, mg/L} = \frac{(\text{Feed Rate, lb/day})}{(\text{Flow, MGD})(8.34 \text{ lb/gal})}$$

$$\text{Dosage, mg/L} = \frac{(\text{Feed Rate, lb/day})(\text{Chemical Purity, \% expressed as decimal})}{(\text{Flow, MGD})(8.34 \text{ lb/gal})}$$

$$\text{Dosage, mg/L} = \frac{(\text{Feed Rate, lb})(\text{Chemical Purity, \% expressed as decimal})}{(\text{Volume, MG})(8.34 \text{ lb/gal})}$$

$$\text{Fluoride Dosage, mg/L} = \frac{(\text{Feed Rate, lb/day})(\text{Available Fluoride Ion, \% expressed as a decimal})(\text{Purity, \% expressed as a decimal})}{(\text{Flow, MGD})(8.34 \text{ lb/gal})}$$

$$\text{Fluoride Saturator Dosage, mg/L} = \frac{(\text{Feed Rate, gpm})(18,000 \text{ mg/L})}{\text{Flow, gpm}}$$

*Pie Wheel Format for this equation is available at the end of this document

Water Treatment Formulas & Conversions

Power

$$\text{Amps} = \frac{\text{Volts}}{\text{Ohms}}$$

$$\text{Amps (Single-Phase)} = \frac{(746 \text{ watts/HP})(\text{Horsepower})}{(\text{Volts})(\text{Efficiency, \% as a decimal})(\text{Power Factor})}$$

$$\text{Amps (Three-Phase)} = \frac{(746 \text{ watts/HP})(\text{Horsepower})}{(1.732)(\text{Volts})(\text{Efficiency, \% as a decimal})(\text{Power Factor})}$$

$$\text{Cost, \$/hour} = (\text{Motor Horsepower, hp})(0.746 \text{ kW/hp})(\text{Cost, \$/kW-hr})$$

$$\text{Electromotive Force*}, \text{ volts} = (\text{Current, amps})(\text{Resistance, ohms})$$

$$\text{Force*}, \text{ lbs} = (\text{Pressure, psi})(\text{Area, in}^2)$$

$$\text{Horsepower} = \frac{(\text{Volts})(\text{Amps})}{(746 \text{ watts/HP})}$$

$$\text{Power, watts (AC Circuit)} = (\text{Volts})(\text{Amps})(\text{Power Factor})$$

$$\text{Power, watts (DC Circuit)} = (\text{Volts})(\text{Amps})$$

$$\text{Power Factor} = \frac{\text{Watts}}{(\text{Volts})(\text{Amps})}$$

Pumps and Motors

Pumping Rate

$$\text{Pumping Rate, gal/min} = \frac{\text{Volume, gal}}{\text{Time, min}}$$

$$\text{Pumping Rate of a Rectangular Tank, gal/min} = \frac{(\text{Length, ft})(\text{Width, ft})(\text{Depth, ft})(7.48 \text{ gal/ft}^3)}{\text{Time, min}}$$

$$\text{Pumping Rate of a Cylindrical Tank, gal/min} = \frac{(0.785)(\text{Diameter, ft})^2(\text{Depth, ft})(7.48 \text{ gal/ft}^3)}{\text{Time, min}}$$


$$\text{Pumping Rate of a Conical Tank, gal/min} = \frac{(1/3)(0.785)(\text{Diameter, ft})^2(\text{Depth, ft})(7.48 \text{ gal/ft}^3)}{\text{Time, min}}$$

$$\text{Time to Fill, min} = \frac{\text{Tank Volume, gal}}{\text{Flow Rate, gal/min}}$$

*Pie Wheel Format for this equation is available at the end of this document

Water Treatment Formulas & Conversions

Pumps and Motors (continued)

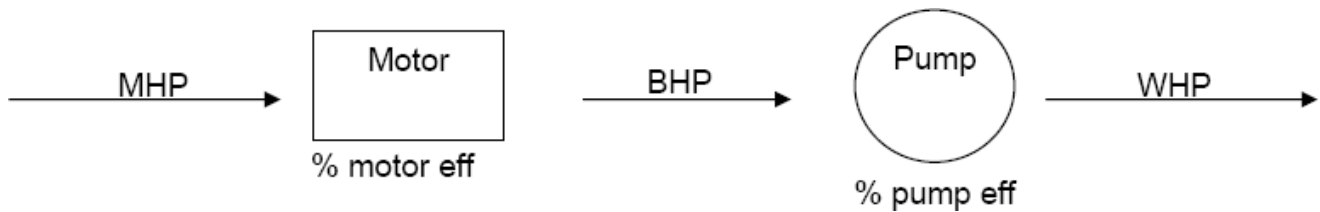

Horsepower

$$\text{Water Horsepower, hp} = \frac{(\text{Flow, gpm})(\text{Head, ft})}{(3,960)}$$

$$\text{Brake Horsepower, hp} = \frac{(\text{Flow, gpm})(\text{Head, ft})}{(3,960)(\text{Pump Efficiency, \% expressed as a decimal})}$$

$$\text{Brake Horsepower, hp} = \frac{\text{Water Horsepower, hp}}{\text{Pump Efficiency, \% expressed as a decimal}}$$

$$\text{Motor Horsepower, hp} = \frac{(\text{Flow, gpm})(\text{Head, ft})}{(3,960)(\text{Pump Efficiency, \% as a decimal})(\text{Motor Efficiency, \% as a decimal})}$$

$$\text{Motor Horsepower, hp} = \frac{\text{Water Horsepower, hp}}{(\text{Pump Efficiency, \% as a decimal})(\text{Motor Efficiency, \% as a decimal})}$$

$$\text{Motor Horsepower, hp} = \frac{\text{Brake Horsepower, hp}}{\text{Motor Efficiency, \% expressed as a decimal}}$$

Efficiency

$$\text{Efficiency, \%} = \frac{\text{Horsepower Output, hp}}{\text{Horsepower Supplied, hp}} \times 100\%$$

$$\text{Motor Efficiency, \%} = \frac{\text{Brake Horsepower, hp}}{\text{Motor Horsepower, hp}} \times 100\%$$

$$\text{Pump Efficiency, \%} = \frac{\text{Water Horsepower, hp}}{\text{Brake Horsepower, hp}} \times 100\%$$

$$\text{Wire-to-Water Efficiency, \%} = (\text{Pump Efficiency, \% as a decimal})(\text{Motor Efficiency, \% as a decimal})(100\%)$$

$$\text{Wire-to-Water Efficiency, \%} = \frac{\text{Water Horsepower, hp}}{\text{Motor Horsepower, hp}} \times 100\%$$

$$\text{Wire-to-Water Efficiency, \%} = \frac{(\text{Flow, gpm})(\text{Total Dynamic Head, ft})(0.746 \text{ kW/hp})}{(3,960)(\text{Electrical Demand, kW})} \times 100\%$$

Water Treatment Formulas & Conversions

Chlorination

CT Calculation = (Disinfectant Residual Concentration, mg/L)(Time,min)

Chlorine Dose, mg/L = Chlorine Demand, mg/L + Chlorine Residual, mg/L

Dosage, mg/L = $\frac{(\text{Feed Rate, lb/day})(\text{Chemical Purity, \% expressed as a decimal})}{(\text{Flow, MGD})(8.34 \text{ lb/gal})}$

Feed Rate, lb/day = $\frac{(\text{Dosage, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})}{\text{Chemical Purity, \% expressed as a decimal}}$

Hypochlorite Feed Rate, gpd = $\frac{(\text{Dosage, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})}{(\text{Chemical Purity, \% expressed as a decimal})(\text{Solution Density, lb/gal})}$

Hypochlorite Strength, % = $\frac{\text{Chlorine Required, lb}}{(\text{Hypochlorite Solution Needed, gal})(8.34 \text{ lb/gal})} \times 100\%$

Substitution of Bleach for Chlorine Gas, gal =

$$\frac{\text{Chlorine Feed, lb}}{(\text{Available Chlorine from Bleach, \% expressed as a decimal})(8.34 \text{ lb/gal})}$$

Substitution of Bleach for HTH, gal =

$$\frac{(\text{Available Chlorine from HTH, \% expressed as a decimal})(\text{HTH Feed, lb})}{(\text{Available Chlorine from Bleach, \% expressed as a decimal})(8.34 \text{ lb/gal})}$$

Substitution of HTH for Bleach, lb =

$$\frac{(\text{Available Chlorine from Bleach, \% expressed as a decimal})(\text{Bleach, gal})(8.34 \text{ lb/gal})}{\text{Available Chlorine from HTH, \% expressed as a decimal}}$$

Substitution of HTH for Chlorine gas, lb = $\frac{\text{Chlorine Feed, lb}}{\text{Available Chlorine from HTH, \% expressed as a decimal}}$

Well Formulas

Well Yield, gal/min = $\frac{\text{Volume, gal}}{\text{Time, min}}$

Drawdown, ft = Pumping Water Level, ft – Static Water Level, ft

Specific Capacity, gpm/ft = $\frac{\text{Well Yield, gal/min}}{\text{Drawdown, ft}}$

Water Treatment Formulas & Conversions

Coagulation/Flocculation

$$\text{Detention Time} = \frac{(\text{Volume})}{\text{Flow}}$$

$$\text{Detention Time, sec} = \frac{(\text{Volume, gal})(1440 \text{ min/day})(60 \text{ sec/min})}{\text{Flow, gpd}}$$

$$\text{Detention Time, min} = \frac{(\text{Volume, gal})(1440 \text{ min/day})}{\text{Flow, gpd}}$$

$$\text{Dosage, mg/L} = \frac{(\text{Feed Rate, lb/day})(\text{Chemical Purity, \% expressed as decimal})}{(\text{Flow, MGD})(8.34 \text{ lb/gal})}$$

$$\text{Feed Rate, lb/day} = \frac{(\text{Dosage, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})}{\text{Chemical Purity, \% expressed as a decimal}}$$

Sedimentation

$$\text{Detention Time} = \frac{(\text{Volume})}{\text{Flow}}$$

$$\text{Detention Time, hr} = \frac{(\text{Volume, gal})(24 \text{ hr/day})}{\text{Flow, gpd}}$$

$$\text{Hydraulic Loading Rate, gpd/ft}^2 = \frac{\text{Total Flow Applied, gpd}}{\text{Area, ft}^2}$$

$$\text{Surface Loading (Overflow) Rate, gpd/ft}^2 = \frac{\text{Flow, gpd}}{\text{Surface Area, ft}^2}$$

Weir Overflow Rate

$$\text{Weir Overflow Rate, gpd/ft} = \frac{\text{Flow, gpd}}{\text{Weir Length, ft}}$$

$$\text{Length of Circular Weir, ft} = (3.14)(\text{Diameter, ft})$$

Solids Removal

$$\text{Reduction in Flow, \%} = \frac{(\text{Original Flow} - \text{Reduced Flow})}{\text{Original Flow}} \times 100\%$$

$$\text{Removal, \%} = \frac{(\text{In-Out})}{\text{In}} \times 100\%$$

$$\text{Solids, mg/L} = \frac{(\text{Dry Solids, g})(1,000,000)}{\text{Sample Volume, mL}}$$

$$\text{Solids Concentration, mg/L} = \frac{\text{Weight, mg}}{\text{Volume, L}}$$

Water Treatment Formulas & Conversions

Filtration

$$\text{Filter Yield, lb/hr/ft}^2 = \frac{(\text{Solids Loading, lb/day})(\text{Recovery, \% expressed as decimal})}{(\text{Filter Operation, hr/day})(\text{Area, ft}^2)}$$

$$\text{Filter Drop Test Velocity, ft/min} = \frac{\text{Water Drop, ft}}{\text{Time of Drop, min}}$$

Backwashing

$$\text{Backwash Water Volume, gal} = (\text{Backwash Rate, gpm/ft}^2)(\text{Backwash Time, min})(\text{Filter Area, ft}^2)$$

$$\text{Backwash Water, \%} = \frac{\text{Backwash Water, gal}}{\text{Water Filtered, gal}} \times 100\%$$

$$\text{Filter Backwash Rise Rate, in/min} = \frac{(\text{Backwash Rate, gpm/ft}^2)(12 \text{ in/ft})}{7.48 \text{ gal/ft}^3}$$

Hook Gauge

$$\text{Volume, gal} = (\text{Filter Length, ft})(\text{Filter Width, ft})(\text{Water Drop or Rise, ft})(7.48 \text{ gal/ft}^3)$$

$$\text{Filtration Rate, gal/min} = \frac{\text{Volume, gal}}{\text{Average Time, min}}$$

$$\text{Filter Bed Area, ft}^2 = (\text{Filter Bed Length, ft})(\text{Filter Bed Width, ft})$$

$$\text{Filter Loading Rate, gpm/ft}^2 = \frac{\text{Flow, gpm}}{\text{Filter Area, ft}^2}$$

Solution Preparation

$$\text{Concentration} = \frac{\text{Concentration, lb/gal}}{\text{Density, lb/gal}} \times 100\%$$

$$\text{Percent Strength, \% (by weight)} = \frac{\text{Weight of Chemical, lbs}}{(\text{Weight of Water, lbs} + \text{Weight of Chemicals, lbs})} \times 100\%$$

$$\text{Three Normal or Blending } (C_1 \times V_1) + (C_2 \times V_2) = (C_3 \times V_3)$$

*Where C = Concentration or Normality
and V = Volume*

$$\text{Two Normal Equation (Dilution)} \quad (C_1 \times V_1) = (C_2 \times V_2)$$

Units must be compatible

$$\text{Chemicals, lbs} = \frac{(\text{Water Volume, gal} \times 8.34 \text{ lb/gal})(\text{Desired Concentration, \%})}{(100\% - \text{Desired Concentration, \%})}$$

$$\text{Water Volume, gal} = \frac{(\text{Chemical, lbs})(100\% - \text{Desired Concentration, \%})}{(\text{Desired Concentration, \%})(8.34 \text{ lb/gal})}$$

Water Treatment Formulas & Conversions

Chemical Feeders

$$\text{Chemical Feed Pump Setting, \% stroke} = \frac{\text{Desired flow}}{\text{Maximum flow}} \times 100\%$$

$$\text{Chemical Feed Pump Setting, mL/min} = \frac{(\text{Dose, mg/L})(\text{Flow, MGD})(3.785 \text{ L/gal})(1,000,000 \text{ gal/MG})}{(\text{Chemical Density, mg/mL})(\text{Active Chemical, \% expressed as a decimal})(1440 \text{ min/day})}$$

$$\text{Dosage, mg/L} = \frac{(\text{Feed Rate, lb/day})(\text{Chemical Purity, \% expressed as decimal})}{(\text{Flow, MGD})(8.34 \text{ lb/gal})}$$

$$\text{Feed Rate, lb/day} = \frac{(\text{Dosage, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})}{\text{Chemical Purity, \% expressed as a decimal}}$$

$$\text{Solution Feeder Setting, gpd} = \frac{(\text{Dose, mg/L})(\text{Flow, MGD})(8.34 \text{ lb/gal})}{\text{Solution Concentration, lb/gal}}$$

$$\text{Specific Gravity} = \frac{\text{Density of substance, lb/gal}}{8.34 \text{ lb/gal}}$$

Distribution Systems Calculations

$$\text{Force}^*, \text{ lbs} = (\text{Pressure, psi})(\text{Area, in}^2)$$

$$\text{Leakage, gpd} = \frac{\text{Volume, gal}}{\text{Time, days}}$$

$$\text{Slope, \%} = \frac{\text{Drop or Rise, ft}}{\text{Distance, ft}} \times 100\%$$

$$\text{Water Use, gpcd} = \frac{\text{Volume of Water Produced, gpd}}{\text{Population Served, capita}}$$

Alkalinity Relationships

All Alkalinity expressed as mg/L as CaCO₃ • P – phenolphthalein alkalinity • T – total alkalinity

Titration Results	Hydroxide	Carbonate	Bicarbonate
P = 0	0	0	T
P is less than ½ T	0	(2)(P)	T – (2)(P)
P = ½ T	0	(2)(P)	0
P is greater than ½ T	(2)(P) – T	(2)(T) – (2)(P)	0
P = T	T	0	0

*Pie Wheel Format for this equation is available at the end of this document

Water Treatment Formulas & Conversions

Laboratory Calculations

$$\text{Average (arithmetic mean)} = \frac{\text{Sum of All Terms}}{\text{Number of Terms}}$$

$$\text{Average (geometric mean)} = [(x_1)(x_2)(x_3)(x_4)\dots(x_n)]^{1/n} \quad \text{The } n\text{th root of the product of } n \text{ numbers}$$

$$\text{Composite Sample Single Portion} = \frac{(\text{Instantaneous Flow})(\text{Total Sample Volume})}{(\text{Number of Portions})(\text{Average Flow})}$$

$$\text{Langelier Saturation Index} = \text{pH} - \text{pH}_s$$

$$\text{Specific Gravity} = \frac{\text{Density of substance, lb/gal}}{8.34 \text{ lb/gal}}$$

$$\text{Threshold Odor Number} = \frac{(A+B)}{A} \quad \text{Where } A = \text{Volume of odor causing sample, and } B = \text{volume of odor free water}$$

Chemistry

$$\text{Milliequivalent} = (\text{mL})(\text{Normality})$$

$$\text{Molarity} = \frac{\text{Moles of Solute}}{\text{Liters of Solution}}$$

$$\text{Normality} = \frac{\text{Number of Equivalent Weights}}{\text{Liters of Solution}}$$

$$\text{Number of Equivalent Weights} = \frac{\text{Total Weight}}{\text{Equivalent Weight}}$$

$$\text{Number of Moles} = \frac{\text{Total Weight}}{\text{Molecular Weight}}$$

Temperature

$$\text{Temperature, } ^\circ\text{C} = \frac{(^{\circ}\text{F}-32)}{1.8}$$

$$\text{Temperature, } ^\circ\text{F} = (^{\circ}\text{C})(1.8) + 32$$

Titration

$$\text{Alkalinity, mg/L as CaCO}_3 = \frac{(\text{Titrant Volume, mL})(0.02 \text{ N})(50,000)}{\text{Sample Volume, mL}}$$

$$\text{Hardness, mg/L as CaCO}_3 = \frac{(\text{Titrant Volume, mL})(1,000)}{\text{Sample Volume, mL}} \quad \text{Only when the titration factor is 1.00 of EDTA}$$

$$\text{Two Normal Equation } (C_1)(V_1) = (C_2)(V_2) \quad \text{Where } C = \text{Concentration or Normality and } V = \text{Volume}$$

Units must be compatible

Common Abbreviations

ac-ft = acre-feet	L = liter
°C = Celsius	lb = pounds
cfs = cubic feet per second	LSI = Langelier Saturation Index
cm = centimeters	m = meters
DO = dissolved oxygen	mg = milligrams
Eff = efficiency	MG = million gallons
EMF = electromotive force	MGD = million gallons per day
°F = Fahrenheit	mi = miles
ft = feet	min = minutes
ft lb = foot-pound	mL = milliliters
g = grams	ppb = parts per billion
gal = gallons	ppm = parts per million
gfd = gallons flux per day	psi = pounds per square inch
gpcd = gallons per capita per day	Q = flow
gpd = gallons per day	RPM = revolutions per minute
gpg = grains per gallon	SDI = sludge density index
gpm = gallons per minute	sec = second
HLR = hydraulic loading rate	SS = settleable solids
hp = horsepower	TOC = total organic carbon
hr = hours	TSS = total suspended solids
in = inches	W = watts
kg = kilograms	WOR = weir overflow rate
km = kilometers	yd = yards
kPa = kilopascals	yr = year
kW = kilowatts	
kWh = kilowatt-hours	

Water Treatment Formulas & Conversions

Unit Conversion Factors

Linear

1 ft = 0.305 m
 1 ft = 12 in
 1 in = 2.54 cm
 1 yd = 3 ft
 1 mi = 5,280 ft

Weight and Mass

1 ft³ of water = 62.4 lb
 1 g = 1,000 mg
 1 gal of water = 8.34 lb
 1 kg = 1,000 g
 1 kg = 2.2 lbs
 1 lb = 0.454 kg
 1 lb = 453.6 g
 1 metric ton = 2,205 lb
 1 mg/L = 0.0584 gpg
 1 gpg = 17.118 mg/L
 1 ton = 2,000 lb
 1% = 10,000 mg/L

Area

1 ac = 43,560 ft²
 1 ac = 0.405 Hectare
 1 m² = 1.19 yd²
 1 ft² = 144 in²
 1 ft² = 0.093 m²
 1 Hectare = 2.47 ac
 π or pi = 3.14

Pressure and Head

1 atm = 33.9 ft of water
 1 atm = 14.7 psi
 1 ft of water = 0.433 psi
 1 psi = 2.31 ft of water

Volume

1 ac-ft = 43,560 ft³
 1 ac-ft = 325,828.8 gal
 1 ft³ = 7.48 gal
 1 L = 0.2642 gal
 1 L = 1,000 mL
 1 gal = 231 in³
 1 gal = 0.1337 ft³
 1 gal = 3.785 L
 1 MG = 1,000,000 gal
 1 m³ = 264 gal
 1 yd³ = 27 ft³

Power


1 hp = 0.746 kW
 1 hp = 746 W
 1 hp = 33,000 ft•lb/min
 1 kW = 1,000 W

Flow

1 cfs = 0.6463 MGD
 1 cfs = 448.8 gpm
 1 MGD = 694.44 gpm
 1 MGD = 1.55 cfs


Metric Conversion Chart

Primary Unit

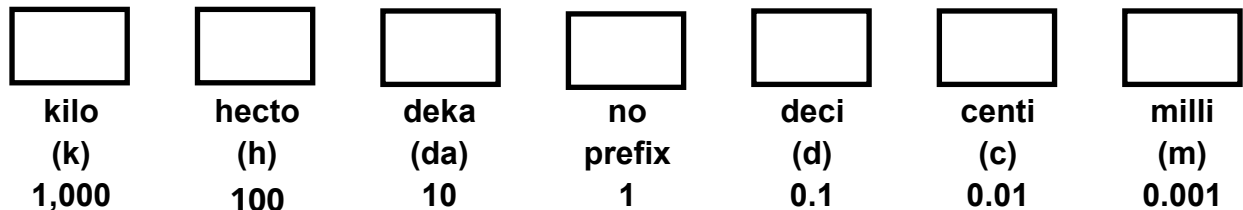

meter (m) - linear measurement
liter (L) - volume measurement
gram (g) - weight measurement

Flow Conversion Chart

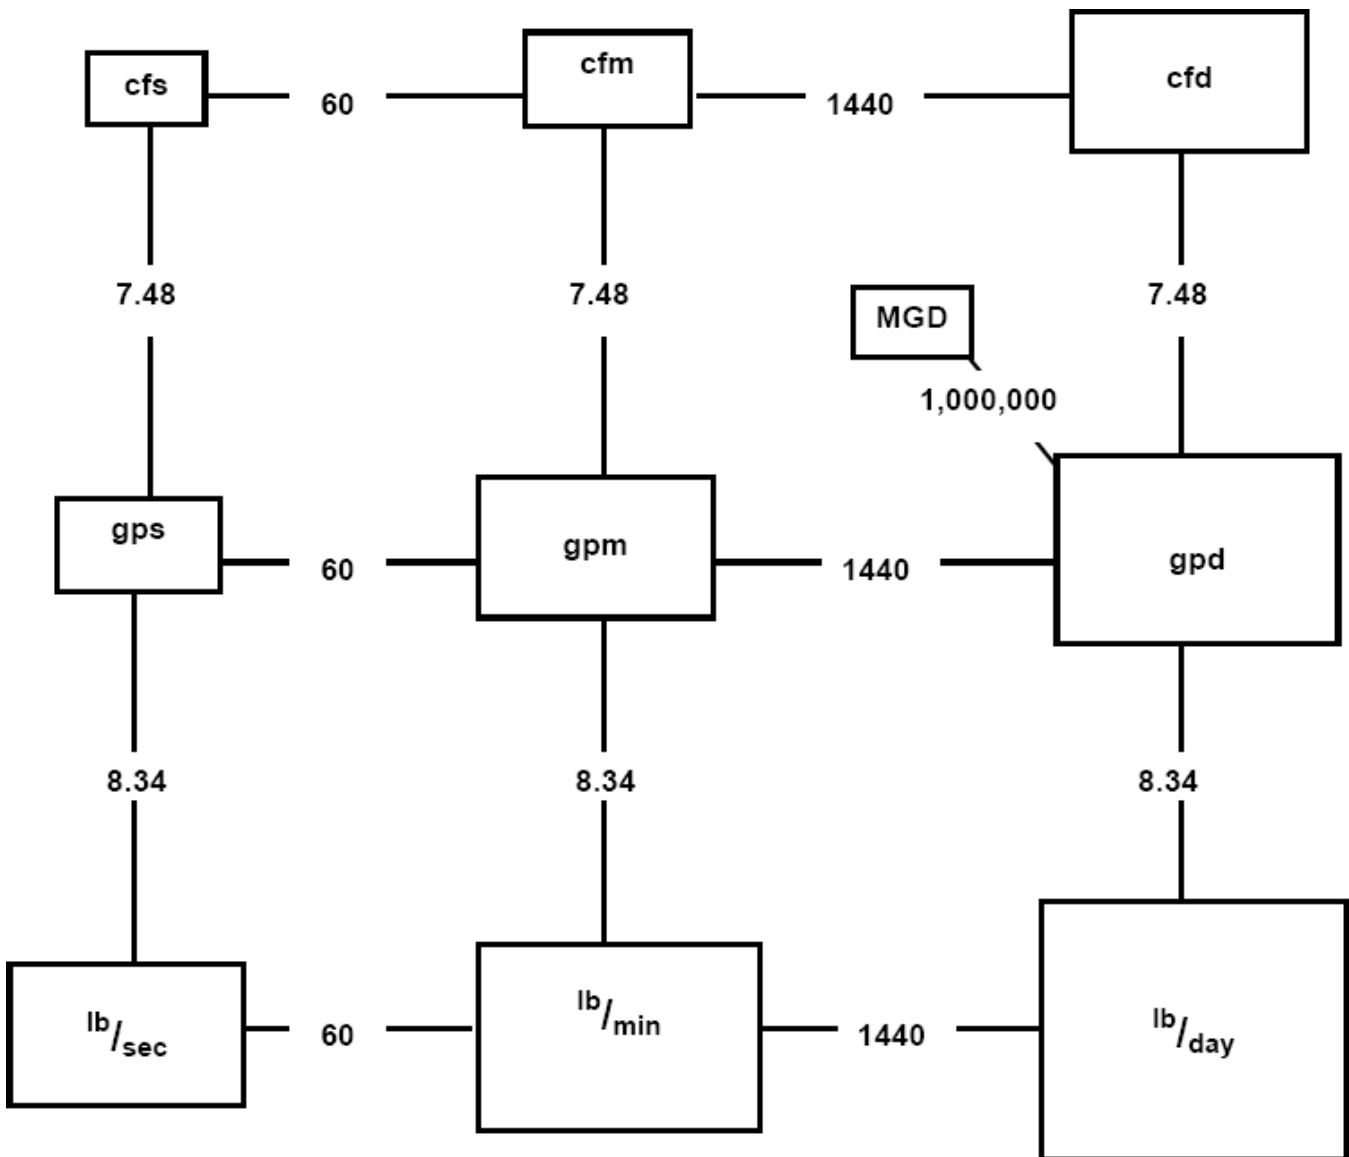

To use this diagram: First, find the box that coincides with the beginning units (i.e. gpm). Then, find the box that coincides with the desired ending units (i.e. cfs). The numbers between the starting point and ending point are the conversion factors.

When moving from a **smaller box to a larger box, multiply** by the factor between them.


When moving from a **larger box to a smaller box, divide** by the factor between them.

Water Treatment Formulas & Conversions


Pie Wheels

- To find the quantity above the horizontal line: multiply the pie wedges below the line together.
- To solve for one of the pie wedges below the horizontal line: cover that pie wedge, then divide the remaining pie wedge(s) into the quantity above the horizontal line.
- Given units must match the units shown in the pie wheel.
- When US and metric units or values differ, the metric is shown in parentheses, e.g. (m²).


Area of Circle

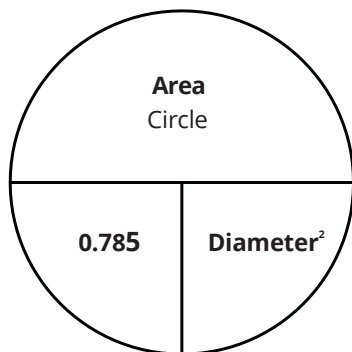


Electromotive Force (EMF), Volts

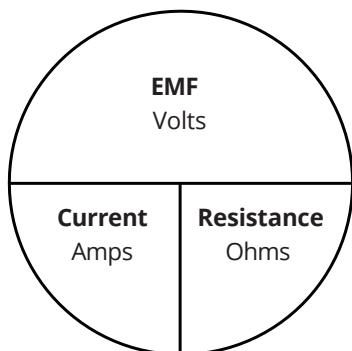


Force, lbs (Newtons)

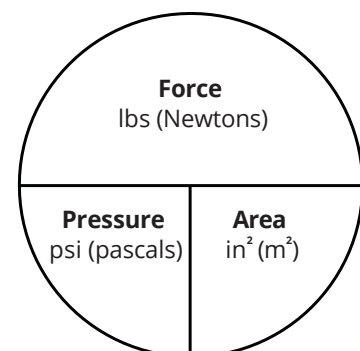


Volume of Cone

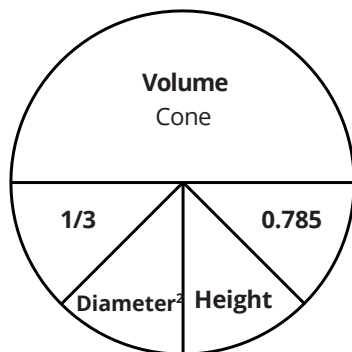


Area of Rectangle

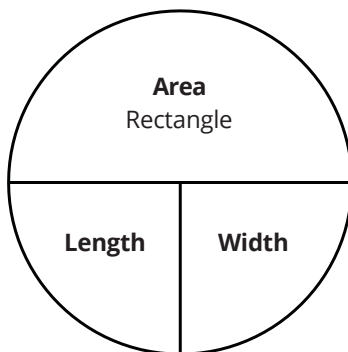


Feed Rate, lbs/day (kg/day)

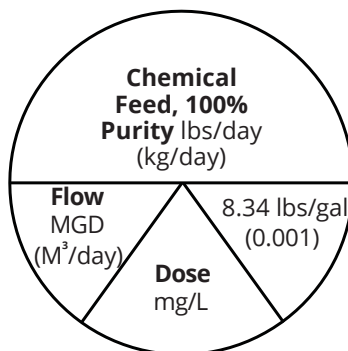


Loading Rate, lbs/day (kg/day)

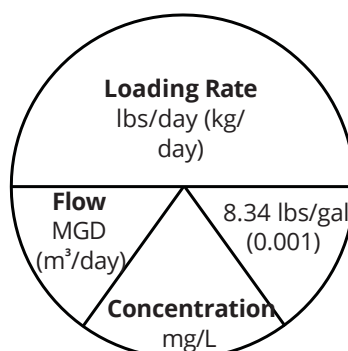


Volume of Cylinder

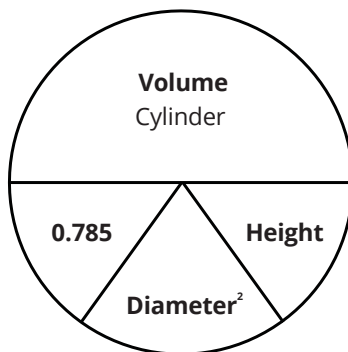


Area of Right Triangle

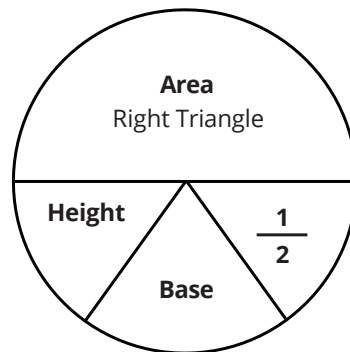

Flow Rate, ft³/sec (m³/sec)

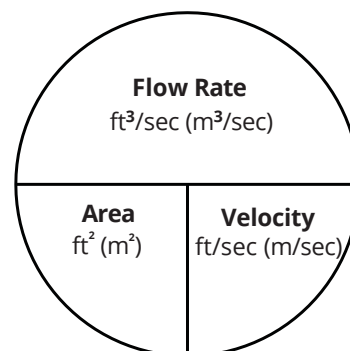

Mass, lbs (kg)

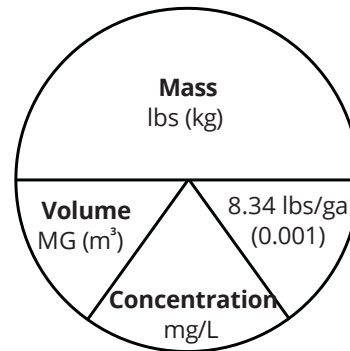

Volume of Rectangular Tank

